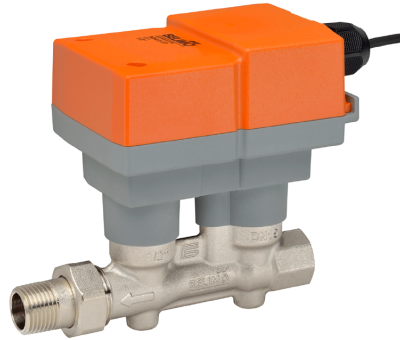


Flow sensor

Calibrated ultrasonic flow sensor, temperature and glycol compensated. With DC 0.5...10 V output signal. This sensor can be used in closed cold and warm water systems and is robust against dirt and magnetite. There is also a low pressure drop across the sensor.


Type Overview

Type	DN	DN ["]	FS [GPM]	Δp [psi]	Voltage output
FM050	15	1/2	6.6	1.75	0.5...10 V
FM075	20	3/4	12.4	1.89	0.5...10 V
FM100	25	1	21.8	1.18	0.5...10 V
FM125	32	1 1/4	34.2	0.9	0.5...10 V
FM150	40	1 1/2	47.5	1.02	0.5...10 V
FM200	50	2	91.2	2.16	0.5...10 V

FS: Full scale, maximum measurable flow

Δp : Pressure drop at FS

Technical Data

Electrical Data	Nominal voltage	AC/DC 24 V
	Nominal voltage frequency	50/60 Hz
	Nominal voltage range	AC 19.2...28.8 V / DC 21.6...28.8 V
	Power consumption AC	1 VA
	Power consumption DC	0.5 W
	Connection supply	cable , 3 x 0.75 mm ²
Functional Data	Sensor Technology	ultrasonic (transit time) with glycol and temperature compensation
	Voltage output	0.5...10 V
	Application	water
	Body Pressure Rating	360 psi
	Installation position	upright to horizontal
	Servicing	maintenance-free
	Velocity Range	0.08-7.73 FPS
Measuring Data	Measuring values	Volume flow
	Measuring fluid	Water and water glycol mixtures
	Measuring principle	Ultrasonic volumetric flow measurement
	Measuring accuracy flow	±2% of the measured value (20...100% FS) @ 20°C / Glycol 0% vol. ±0.4% of FS (0...20% FS) @ 20°C / Glycol 0% vol.
	Measuring accuracy flow note	±6% of the measured value (20...100% FS) ±1.2% of FS (0...20% FS)
	Flow Measurement Repeatability	±0.5%
	Min. flow measurement	1% of Max Flow
	Materials	Fluid wetted parts
Flow measuring pipe		brass body nickel-plated

Safety Data	Ambient humidity	max. 95% r.H., non-condensing
	Ambient temperature	30...120°F [0...50°C]
	Fluid temperature	-5...250°F [-20...120°C]
	Storage temperature	-40...176°F [-40...80°C]
	Protection class IEC/EN	III Safety Extra-Low Voltage (SELV)
	Protection class UL	UL Class 2 Supply
	Certification IEC/EN	IEC/EN 60730-1
	Certification UL	cULus acc. to UL94 D5 E108966
	Degree of protection IEC/EN	IP54
	Degree of protection NEMA/UL	NEMA 2
	Enclosure	UL Enclosure Type 2
	Quality Standard	ISO 9001
	Mode of operation	Type 1
	Rated impulse voltage supply	0.8 kV

Safety Notes


This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.

Outdoor applications: Only possible where (sea) water, snow, ice, sunlight or aggressive gases cannot interfere directly with the device and it can be guaranteed that the ambient conditions remain at all times within the thresholds according to the data sheet.

Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.

The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

Product Features


Mode of operation The ultrasonic flow sensor is equipped with a flow pipe, four flow transmitters and an electronic circuit. A temperature sensor is mounted in the flow pipe to compensate the temperature effects.

A sensor error occurs when the ultrasonic path is interrupted (air bubbles in the system, connection to ultrasonic transducers interrupted).

Patented glycol compensation Glycol changes the viscosity of the heat transfer fluid and as a result affects the measured volumetric flow. Without glycol compensation, volumetric flow measurements can show errors of as much as 30 percent. The patented automatic glycol compensation significantly reduces the degree of measurement error.

Installation notes

Recommended installation positions The sensor can be installed upright to horizontal. The sensor may not be installed in a hanging position.



Installation in return Installation in the return is recommended.

Inlet section In order to achieve the specified measuring accuracy, a flow-calming section or inflow section in the direction of the flow is to be provided upstream from the flow sensor. Its dimensions should be at least 5x DN.



Water quality requirements The water quality requirements specified in VDI 2035 must be adhered to.

Servicing Sensors are maintenance-free.

Before any service work on the sensor is carried out, it is essential to isolate the sensor from the power supply (by unplugging the electrical cables if necessary). Any pumps in the part of the piping system concerned must also be switched off and the appropriate slide valves closed (allow all components to cool down first if necessary and always reduce the system pressure to ambient pressure level).

The system must not be returned to service until the sensor has been correctly reassembled in accordance with the instructions and the pipeline has been refilled by professionally trained personnel.

Flow direction The direction of flow, specified by an arrow on the housing, is to be complied with, since otherwise the flow rate will be measured incorrectly.

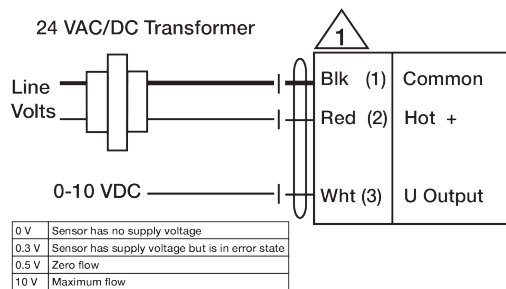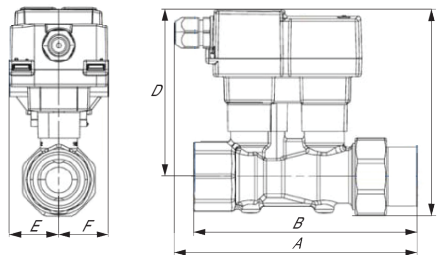Wiring Diagram
Notes Connection via safety isolating transformer.

Dimensions


Type	DN	DN ["]	A_1	B_1	C_1	D_1	E_1	F_1	Weight
FM050	15	1/2	4.5" [114]	4.3" [108]	4.9" [124]	4.3" [110]	1.5" [39]	1.5" [39]	1.7 lb [0.750 kg]
FM075	20	3/4	5.1" [129]	4.6" [118]	5.1" [129]	4.4" [113]	1.5" [39]	1.5" [39]	1.9 lb [0.870 kg]
FM100	25	1	5.4" [136]	4.9" [125]	5.2" [132]	4.5" [115]	1.5" [39]	1.5" [39]	2.4 lb [1.1 kg]
FM125	32	1 1/4	5.5" [140]	5.0" [127]	5.6" [141]	4.6" [117]	1.5" [39]	1.5" [39]	2.8 lb [1.3 kg]
FM150	40	1 1/2	5.6" [143]	5.2" [131]	6.1" [154]	4.8" [122]	1.5" [39]	1.5" [39]	3.7 lb [1.7 kg]
FM200	50	2	5.9" [149]	5.4" [137]	6.5" [165]	5.0" [127]	1.5" [39]	1.5" [39]	4.6 lb [2.1 kg]