

**Type Overview** 

### Frost monitor

For monitoring the temperatures of water/air heaters in ventilation and air-conditioning systems to prevent frost damage to the cooling registers. Manual or automatic reset versions and adjustable setpoints. The frost alarm is provided with a single-pole double-throw (SPDT) changeover switch.





Туре	Output signal fro	st protection switch	Additional features	S Capillary
01ATS-104XC	Changeover		Manual reset	3 m
)1ATS-105XC	Changeover		Manual reset	6 m
01ATS-1040B	Changeover		Auto reset	3 m
01ATS-1050B	Changeover		Auto reset	6 m
Technical data				
	Electrical data	Electrical connection		Spring loaded terminal max. 2.5 mm <sup>2</sup>
		Cable entry		Cable gland with strain relief M20x1.5 mm, fo cable ø612 mm
Functional o	Functional data	Medium		Air
		Output signal frost pro	tection switch note	AC 230 V 16 (2.5) A @ Switch position 1-2 AC 230 V 2 (0.4) A @ Switch position 1-4 DC 230 V 0.25 A
		Switching reliability		Min. switching current 100 mA @ AC / DC 24
	Measuring data	ta Measured values		Temperature
Specification ter	ification temperature active Long term stability			2 K according to DIN EN 14597
Specification temperature	perature passive	Measuring range		-1015°C [1560°F] Default setting: 5°C [41°F]
		Adjustment range		-1015
		Switching differential		1.5 K (±1 K tolerance)
		Accuracy temperature		Setting accuracy: ±2 K
		Time constant τ (63%) i	in the air duct	Typical <25 s @ 1 m/s
Safety data		Degree of protection IE	EC/EN	IP65
	-	EU Conformity		CE Marking
		Quality Standard		ISO 9001
		Ambient humidity		Max. 95% RH, non-condensing
		Ambient temperature		-2080°C [-4175°F] The ambient temperature must exceed the switching point by +2 K.
		Fluid temperature		Up to max. 120°C
		Storage temperature		-3080°C [-22176°F]
	Materials	Housing		Bottom: PA (RAL 7001, silver grey) Cover: ABS with inspection glass (PMMA) Seal: NBR
		Cable gland		PA6, black
		Capillary		Copper



#### Safety notes



This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application. Unauthorised modifications are prohibited. The product must not be used in relation with any equipment that in case of a failure may threaten humans, animals or assets.

Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied with during installation.

The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.



During installation, testing, servicing and troubleshooting of this product, it may be necessary to work with live electrical components. Have a qualified licensed electrician or other individual who has been properly trained in handling live electrical components perform these tasks. Failure to follow all electrical safety precautions when exposed to live electrical components could result in death or serious injury.


#### Remarks

#### General remarks concerning sensors

The ambient temperature must exceed the switching point by +2 K.

For the switching function to be reliable, the ambient temperature at the housing must exceed the set switching point by more than 2 K.

Install the frost monitor inside the air duct if necessary in case of application in low ambient temperatures.

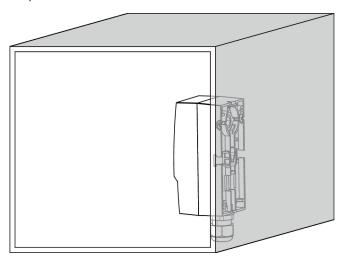



### **Switching function**

If the capillary line falls below the entered setpoint value, over a length of 150 mm with 3 m, 300 mm with 6 m, then electrical circuit 1-2 is opened while electrical circuit 1-4 is closed due to the changeover function.



#### **Remarks**

#### Reset function

Auto reset


When the temperature rises, the microswitch is automatically switched back to its original position.

If the measuring system is destroyed (i.e. if the expansion fluid escapes) the pressure in the diaphragm drops and permanently opens electrical circuit 1-2 and closes electrical circuit 1-4.

Manual reset

The types with manual reset lock automatically when the temperature drops and can only be unlocked manually after the temperature has risen.


If the measuring system is destroyed (i.e. if the expansion fluid escapes) the pressure in the diaphragm drops and permanently opens electrical circuit 1-2 and closes electrical circuit 1-4.

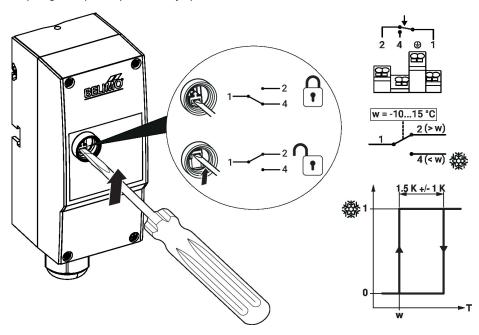

### Parts included

Description	Туре
Mounting kit	A-22D-A08


## Wiring diagram

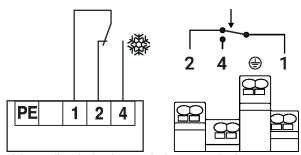

If the capillary leaks, the switch changes to the frost position.



# **Dimensions**

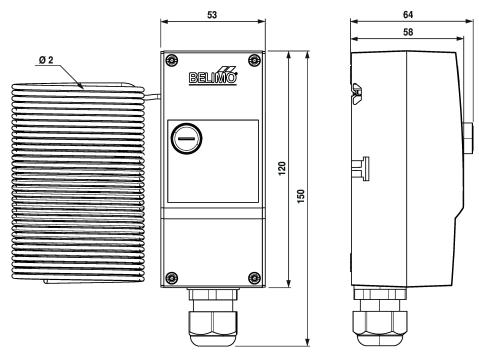

Туре	Weight
01ATS-104XC	0.35 kg
01ATS-105XC	0.42 kg
01ATS-1040B	0.35 kg
01ATS-1050B	0.42 kg

# **Further documentation**

• Installation instructions